


TECHNICAL DATA SHEET 94.18.020 to 063

Product Name	End Cap
Intended Use	Plumbing Systems



Dim.	PRODUCT CODE-9418...				
DN	20	25	32	50	63
e1	4,3±0,2	4,5±0,2	5,6±0,3	8,8±0,3	11,2±0,3
L1	15,5±0,3	16,8±0,3	19,2±0,4	23,2±0,4	26,3±0,4
D1	19,2±0,3	24,2±0,3	31,1±0,4	48,1±0,4	61,2±0,4
D2	19±0,3	24±0,3	30,9±0,4	48±0,4	61±0,4

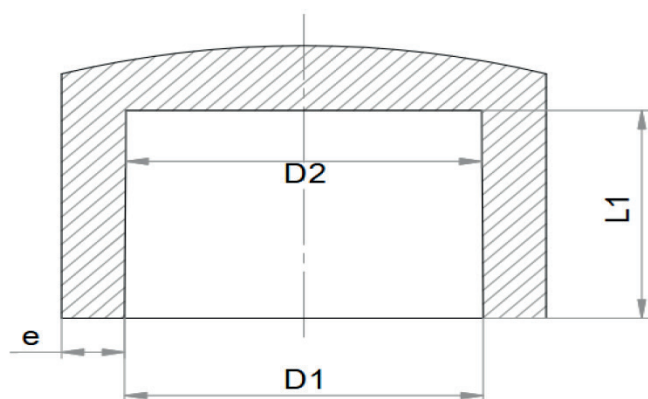

Max. design temperature, Tmax, in °C	80	
Design stress of fitting material, σ_{DF}, in MPa	3,02	
Test temperature, T_{test}, in °C	20	95
Test duration, t, in h	1	1000
Hydrostatic stress of fitting material, σ_F, in MPa	16	3,5
Test pressure, p_F, in bars,		
For a design		
pressure, p_D, of: 4bar	23,1 b	5,1b
6 bar	31,8	7,0
8 bar	42,5	9,3
10 bar	53,1	11,6
Number of test pieces	3	3

MATERIALS

BODY	PPR
-------------	-----

INSTALLATION and USAGE INSTRUCTION

- 1- Fittings must not be exposed to sunlight and must be protected from hard and sharp impacts.
- 2- Fittings to be installed must be clean, and dirty materials must not be welded.
- 3- Ensure that the welding dies used in the process comply with standards, do no weld with worn dies.
- 4- Protect the fittings from areas where they might freeze, as freezing expansion can damage them.

A-) Generally the highest test temperature is take to be (T_{max}+10) °C with an upper limit of 95 °C. However to match existing test facilities the highest test temperature for classes 1 and 2 is also set at 95°C. The hydrostatic stresses given correspond to the given test temperatures. A-) The °C, 10 bar, 50 years, cold water requirement, being higher, determines this value (see ISO 15874-1:2013, Clause 4)